IM-3303 SERIES SYSTEM WIRING DIAGRAM

USE THIS DIAGRAM FOR REFERENCE ONLY – SEE IR-104 ROUGH-IN FRAME INSTALLATION INSTRUCTIONS FOR DETAILED WIRING
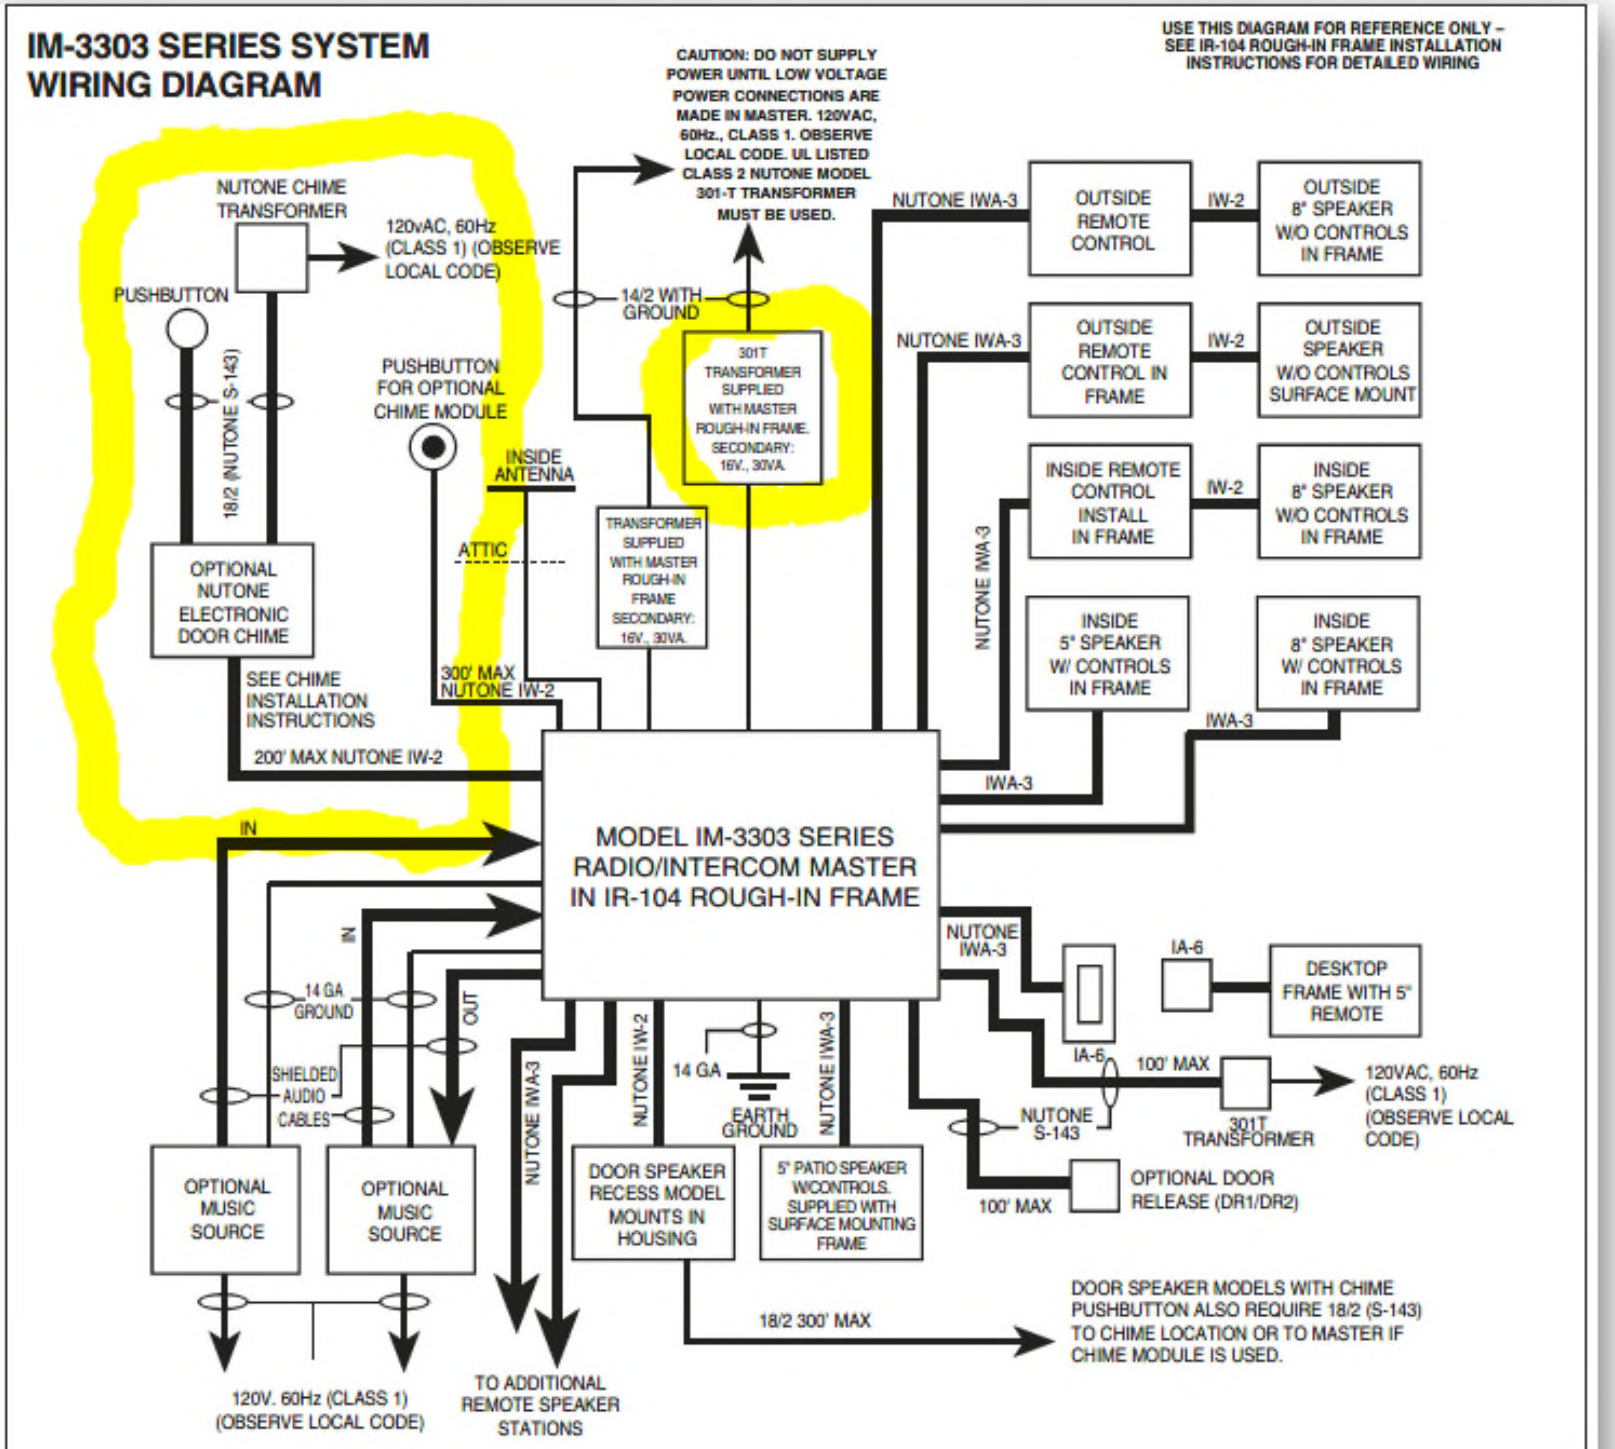
CAUTION: DO NOT SUPPLY POWER UNTIL LOW VOLTAGE POWER CONNECTIONS ARE MADE IN MASTER. 120VAC, 60Hz., CLASS 1. OBSERVE LOCAL CODE. UL LISTED CLASS 2 NUTONE MODEL 301-T TRANSFORMER MUST BE USED.